

## Design and Implementation of an AC Power Generator using DC Motor

Abdulrahman O. Yusuf<sup>1</sup>, Lukman S. Ayinla<sup>2</sup>, Usman A. Usman<sup>3</sup>, Hamed K. Gbigbadua<sup>4</sup>

<sup>1,2</sup>Department of Computer Engineering, University of Ilorin, Ilorin, Nigeria

<sup>3,4</sup>Department of Electrical/Electronics Engineering, Federal University of Technology, Minna, Nigeria

Email: [yusuf.oa@unilorin.edu.ng](mailto:yusuf.oa@unilorin.edu.ng), [ayinla.sl@unilorin.edu.ng](mailto:ayinla.sl@unilorin.edu.ng),  
[usman.abraham@futminna.edu.ng](mailto:usman.abraham@futminna.edu.ng), [hamedkarle@gmail.com](mailto:hamedkarle@gmail.com)

### Abstract

Reliable and efficient supply of electricity is an unavoidable prerequisite to development of any nation since it is the major power source that drives most technologies. This paper describes the design and implementation of an AC power generator that generates electrical energy from an alternator using DC motor as the prime mover. The alternator armature shaft was coupled directly with DC motor, which was powered by high current rechargeable battery. The DC motor rotates the armature of the alternator in the field coil at high speed when powered. This result in two a.c output voltages of 12V and 220V from the alternator. The 12V output was feedback to recharge the battery by the means of a diode while the 220V output was used to drive any a.c load connected to the generator. The 12V output provides constant recharging of the battery as the DC motor consumes energy from the rechargeable battery. The system was also designed with control and display circuitries for automatic switching ON/OFF of the generator and to monitor the voltage output from the grid and generator to select the best output to the load respectively. It also incorporates a buzzer to give an alarm when fault is detected and to isolate the load.

**Keywords:** Alternator, DC Motor, Electricity, Electromagnetic Induction, Magnetic Flux, Prime Mover, Rechargeable Battery.

### 1.0 Introduction

Electricity is the major power source that drives most technologies hence it is demanded in large capacity. Regular and adequate supply of electricity is an unavoidable prerequisite to any nation's development. Any nation whose energy need is epileptic in supply, prolongs her development (Onochie, Egware, & Eyakwanor, 2015). Presently in Nigeria, power generating is mainly from thermal plants (about 61%) while hydro power generating is about 31%. Most of the generating assets in the public power sector are old. Lack of timely routine maintenance had caused significant deterioration in plant output and is a key explanatory factor in the lingering electric power crisis (Ajav & Adewumi, 2014). According to industry watchers, more than two decades of poor planning and underinvestment had left a huge supply deficit. There is no new infrastructure in over a decade despite rapid population growth and rising demand for power (Nigeria Power Sector Report, 2008). The process of generating the electricity is a key factor to the depletion in ozone layer, noise and environmental pollution (Ajav, 2012). The challenges associated with conventional energy source more especially hydroelectric power supply is the need for flowing river with high potential water head, large land mass, in addition to the adverse effect on the aquatic habitat and also settlements close to the site during flood or natural disaster.

Recently, increase in energy demand and limited energy sources in the world caused the researchers to make effort to provide new and renewable energy sources for the usage in an economical and safe way (Adewumi, 2016). Besides being clean and of low running cost,

renewable energy possesses the privilege of abundance and can be used wherever available (Ibrahim & Serag, 2011). A common disadvantage with renewable energy source is that it is difficult to produce the large quantities of electricity that may be required and the cost of initiating them is high.

Other evolutionary trends that leads to generating energy from non-renewable sources like coal, fuel, gas, nuclear and so on, have the benefit of generating energy of large capacity, at low cost. However, the residual from the generation process is highly toxic which depletes the ozone layer, pollutes the habitat and endanger lives (Ajav & Adewumi, 2014). The most common way of generating electricity from non-renewable energy source which is used as a backup in both residential and industrial areas is the fuel or diesel generator. The fuel or diesel generator operates by combusting hydrocarbon fuel to exert a rotational force to the alternator axis which produces a torque from the mechanical power supplied from it (Theraja & Theraja, 2007). It requires less capital to set up the system compared to the grid system and it is also portable, which gives it the benefit to be used in remote areas. Nevertheless, the running cost of the generator is a challenge to the user on the long run and it causes noise pollution to the immediate environment. Also gases like carbon monoxide (CO) released from the combustion of the hydrocarbon fuel are hazardous to human health, poses threat to the environment and contribute to the depletion of ozone layer (Abatan, Adewale, & Alabi, 2013). This motivated the use of a DC motor as a prime mover to the alternator to mitigate some of these effects.

## **2.0 Literature Survey**

Otulana et al (2012) worked on Construction of a Fuelless Generator. They developed a fuelless generator by using locally sourced materials with driving mechanism of 1hp DC motor, powered by a 12V battery, which spines the 0.95KW alternator to produce electricity, while recharging the battery by means of a diode with an output of 1KVA. Adewumi (2016) in Development of 2.5kva Self-Induced Power Generating Set focused on emergence of self-induced engine as a possible alternative for isolated power generation from renewable energy sources because of its low cost, low maintenance cost and reliability. The constructional features include an alternator, DC motor, 12V 100Ah battery, AVR panel and charging panel. The power transmission was done by direct coupling method. The evaluation of the self-induced generator was done by loading it with varying loads that range from 0 to 2000W bulbs for a time of 300seconds for each load. The research revealed that the self-induced power generating set must make use of new direct current motor and alternator for future study for reliability and better performance of the system. Dipali, Shelke & Shital (2017) in Review of Fuelless Generator construct a simple and efficient means of generating electrical energy with readily and easily available materials. The authors revealed that system can be built to any capacity, depending on the capacity of the intending load and does not require any mechanical service or maintenance.

## **2.1 Proposed System**

The DC motor of the proposed system was powered by high current rechargeable battery and used as a prime mover to exert a rotational force on the alternator. The system includes a control circuit that automatically switches on or off the generator, monitors the voltage output from both the grid and generator system to select the best source as output to the load. It also indicates the working condition, gives an alarm when fault is detected. Essential protective devices are also incorporated to protect, isolate the system or load from short circuit, overload, switching and magnetizing surge.

### 3.0 Material and Methods

#### 3.1 Material

The essential components used in the design are Rechargeable Battery, DC Motor, Alternator, Automatic Voltage Regulator (AVR), Coupler, Connecting Cables, Digital Multi-Meter and other basic electronic components that constitute the Control and Display Circuits.

#### 3.2 Methodology

The generator was built by direct coupling of a 2KVA alternator with 1hp DC motor that act as a prime mover to the synchronous generator. The DC motor was powered by external rechargeable DC voltage battery for separate excitation of both the field coil and the rotor winding of the DC motor at the first phase. The alternator works on the principle of Faraday's Laws of electromagnetic induction to generate an induced electromotive force (e.m.f) whenever the magnetic flux linked with a circuit changes (Singh, Murthy, & Gupta, 2006) as cited by (Rajaendra K. Prasad et al, 2012). The alternator rotor was the conductor placed in the magnetic field of the stator which was linked together by magnetic flux, and the rotational force was applied to the rotor by the prime mover.

Mathematically,

$$\text{Induced e.m.f} = \frac{N\phi_2 - N\phi_1}{t} \tag{1}$$

Where,

$N\phi_1$  = Initial flux linkages,  $N\phi_2$  = Final flux linkages,  $N$  = Coil Number of turns,  $t$  = Time  
Rearranging (1) in differential form, we have:

$$e = \frac{d}{dt} (N \phi) = - N \frac{d\phi}{dt} \tag{2}$$

The DC motor was designed based on related principle of electromagnetic induction but instead of it generating an induced e.m.f, a DC voltage was supplied to the rotor winding in the field coil (stator winding) which was linked together through the magnetic flux and causes rotational motion of the rotor winding in the field coil. During the DC motor operation, a back *e.m.f* ( $e_b$ ) was experienced; an induced voltage in the coil of DC motor due to the generator effect. The back *e.m.f* as quantified in (3) opposes the external applied voltage to the coil; as a result it tends to reduce the motor current.

$$e_b = \left[ \frac{p \times Z \times N \times \Phi}{60 \times C} \right] \tag{3}$$

Where,  $C$  = Number of parallel paths of conductor in armature,  $Z$  = Number of conductors in armature,  $N$  = Speed of shaft rotation in r.p.m,  $\Phi$  = Flux Density,  $p$  = Number of poles.

For a Lap Wound DC motor,  $C = p$

$$\text{Hence } e_b = \frac{p \times Z \times N \times \Phi}{60} \tag{4}$$

$$e_b \propto w, \tag{5}$$

$$e_b = k_c w \tag{6}$$

$$\text{Where, } w = \frac{2\pi \times N}{60} \tag{7}$$

$w$  = angular speed and  $k_c$  = Voltage Constant.

The armature voltage  $V$ , consist of two parts; Back *e.m.f* ( $e_b$ ), and voltage drop across armature resistance ( $i_a R$ ).

$$V = i_a R + e_b \tag{8}$$

Multiplying (8) by  $i_a$

$$V i_a = i_a^2 R + e_b i_a \tag{9}$$

Where,  $V_{i_a}$  = Electric power supplied to the armature,  $i_a^2 R$  = Power loss due to armature resistance,  $e_b i_a$  = Mechanical Power (P) developed by the DC motor

$$\text{Torque (T)} = \frac{P}{w} = \frac{\text{Mechanical Power}}{\text{Angular Speed}} \quad (10)$$

$$\text{Since, } P = e_b i_a \quad (11)$$

Substituting for  $w$  from (7)

$$T = \frac{e_b i_a \times 60}{2\pi \times N} \quad (12)$$

$$\text{Recall from (3), } e_b = \left[ \frac{Z \times \Phi \times N \times P}{60 \times 2\pi \times K_c} \right]$$

Therefore, substituting for  $e_b$  in (12)

$$T = \frac{\left[ \frac{Z \times \Phi \times N \times P}{60 \times 2\pi \times K_c} \right] \times i_a \times 60}{2\pi \times N \times C} \quad (13)$$

$$T = \frac{Z \times \Phi \times P \times i_a}{2\pi \times N \times C} \quad (14)$$

$$\text{From (14), } T \propto i_a \text{ at constant speed} \quad (15)$$

$$\text{So, } T = k_T i_a \quad (16)$$

Where  $k_T$  = Torque Constant

The effective torque which overcomes first rotational torque at current  $i_a$  is;

$$T = k_T i_a - T_f \quad (17)$$

$$\text{Hence } i_a = \frac{T + T_f}{k_T} \quad (18)$$

Substituting (18) into (8)

$$V = \frac{T + T_f}{k_T} R + e_b \quad (19)$$

Putting (6) into (19)

$$V = \frac{T + T_f}{k_T} R + k_c w \quad (20)$$

$$k_c w = V - \frac{T + T_f}{k_T} R \quad (21)$$

$$\text{So, } w = \frac{V}{k_c} - \frac{T + T_f}{k_T \times k_c} R \quad (22)$$

$$w = \frac{\left[ \frac{(k_T \times V) - (R \times T_f)}{(k_T \times k_c)} \right]}{(k_T \times k_c)} \quad (23)$$

$$w = \frac{[(k_T \times V) - (R \times T_f)]}{(k_T \times k_c)} - \frac{(R \times R)}{(k_T \times k_c)} \quad (24)$$

Practically,  $T_f \neq 0$ ,

$$w = \frac{[(k_T \times V) - (R \times T_f)]}{(k_T \times k_c)} \quad (25)$$

Equation 25 describes the speed (angular) of a DC motor based on the power supplied to it. The electric power supplied to the armature was evaluated from (9) to calculate the mechanical power developed by the DC motor with the power loss to the armature resistance. However, the battery used as the source of power to the DC motor will be recharged back automatically as it is being used simultaneously just like the electrical system of an automobile system. Equations 26, 27, 28, 29 were used to determine the design specification of the battery used.

$$P = IV \quad (26)$$

Taking DC motor of 12V and 1hp as consideration to calculate the current rating of the battery,  $V = 12V$ ,  $P = 1hp$  and  $1hp = 0.7457 \text{ kW} = 745.7W$

$$\text{Since } P = IV, I = \frac{P}{V} \quad (27)$$

$$W = VA \times \cos\phi \quad (28)$$

$$\text{Therefore, } VA = \frac{W}{\cos\phi} \quad (29)$$

Where  $\cos\phi$  is the power factor = 0.8,

$$\text{Hence } VA = \frac{W}{\cos\phi} = \frac{745.7}{0.8} = 932.125VA = 0.932kVA$$

Substituting the power in VA to (29)

$$I = \frac{P}{V} = \frac{932.125}{12} = 77.68A$$

The current rating of the battery used is 78A and the voltage rating is 12V with 1hp power, based on the DC motor specifications.

### 3.3 Control Circuit

Control circuit which automatically switch ON or OFF the system when used as back up to the grid system was included within the generator system. This was achieved by using Atmega8L microcontroller which samples the voltage level of the voltage divider circuit and execute analogue to digital conversion. The sampled signal was used to toggle the input signal of the transistor, display information about the generator on the Liquid Crystal Display (LCD) and also indicate the present operating state on the Light Emitting Diode (LED). The block diagram for the whole system is shown in Fig. 1 while the overall circuit diagram of the control circuit is shown in Fig 2.

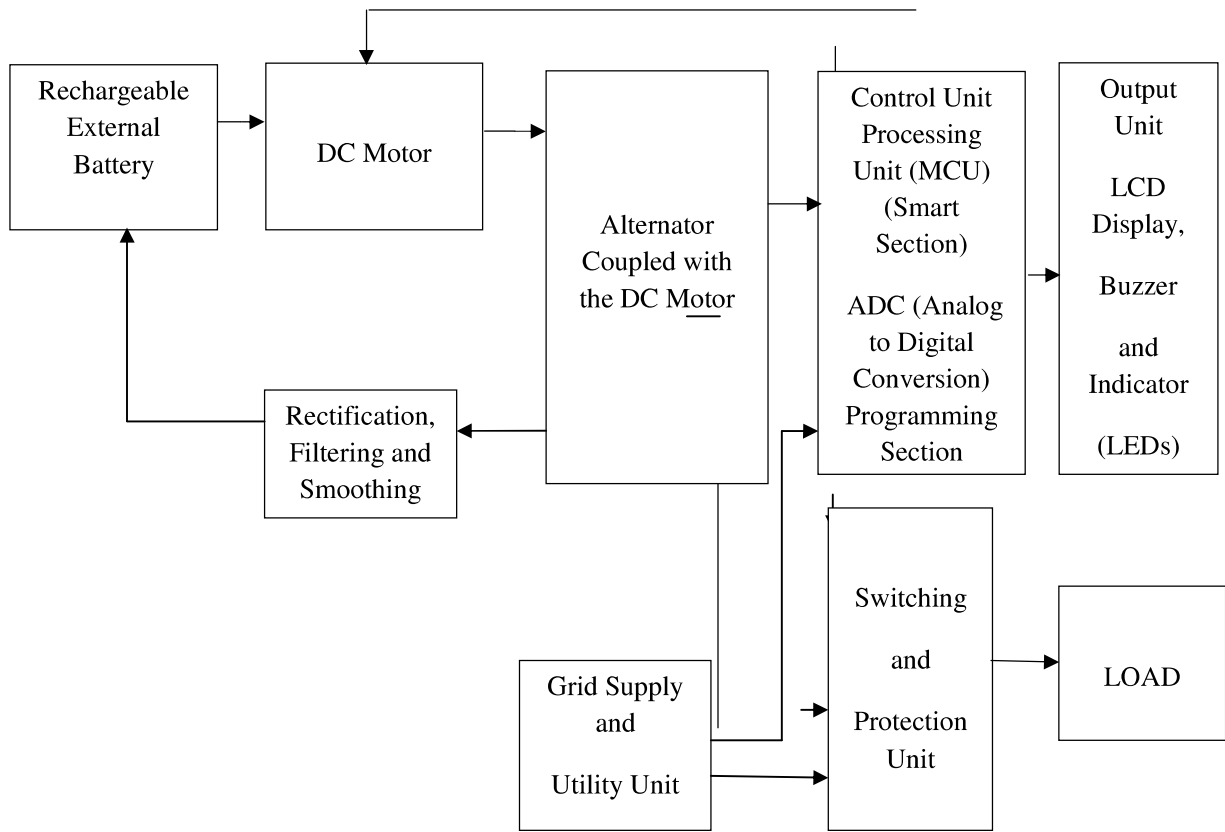


Fig. 1: Block Diagram of the AC Power Generator System

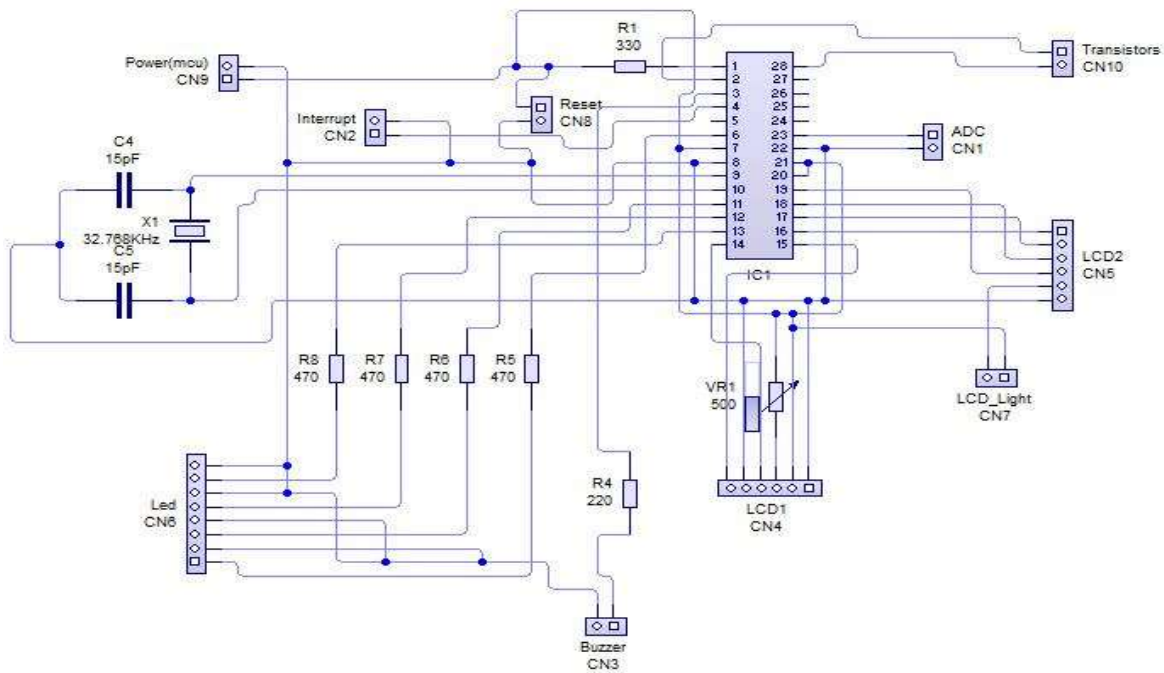


Fig. 2: Circuit Diagram of the Control Unit

#### 4.0 Results and Discussion

The multi-meter was switched to ac readings for measuring high voltage and test was carried out on the generator system under different loads and readings were obtained from the circuit breaker output as presented in table 1.

Table 1: Test results from the Generator under different Loads

S/No	Components and Ratings	Quantity	Connected Load (Watt)	Connected Load (VA)	Current (Amps)	Voltage Output (Volts)
1	Incandescent Lamp (60W)	2	120	150	0.6890	218
2	Fan (100W)	1	100	125	0.5787	218
3	Energy Saver Bulb (40W)	2	80	100	0.4592	218

The multi-meter was also used to measure the power input and output of various units. The voltage output from different components of the control circuit were obtained and presented in table 2.

Table 2: Test results on Power Supply unit from various components

Components	Voltage Outputs (V)
Transformer	24.00
Rectifier	20.80
7812 Voltage Regulator	11.78
7805 Voltage Regulator	4.86
Microcontroller	4.84
12V Relay	11.58
LED Connected in shunt	1.95
Buzzer	4.75
LCD (Liquid Crystal Display)	4.76
24V Relay	22.65

The overall system as shown in Fig. 3 was tested and readings were taken, that meet the design specifications and functionalities of each of the components used in the circuit design. From table 2, test was carried out at various points in the circuit. Result obtained from the load shows that the system can deliver about 1.6kW power output which can power two standard households. When the generator was powered on, the first circuit breaker switches the control circuit which was controlled automatically to power the load and the system can be switched off with the second circuit breaker. The system mode and status was displayed on the LCD, the indicator specifies the current state, while the buzzer produces an alarm whenever there is fault which were indicated by the LEDs and displayed on the LCD. Based on the result from table 1, an increase in the load connected produces an increase in the current drawn from the generator.



Figure 3: AC Power Generator System

## 5.0 Conclusion

AC power generator was designed and implemented to generate clean and environmental friendly electrical energy using DC motor as the prime mover to the alternator. The system results in two output voltage of 12V and 220V respectively. The embedded control circuit permits automatic switching to and from the national grid while the alarm and display circuit are useful for fault detection and mode display respectively. The alternator has diodes that give polarity to the batteries and capacitor that stores electrical charges and smoothen the electricity supplied by the alternator respectively. The application of the system to generate electricity is restricted to capacity of both the D.C. motor and the alternator. The dc motor capacity must exceed that of the alternator coupled to the dc motor in order to produce maximum alternator output capacity. This implies that the availability of DC motor and alternator of large capacity gives the system its potentials in order to solve problem of the generation and distribution of electricity that is usually inadequate.

## References

- Abatan, O., Adewale, A., & Alabi, A. (2013). Constant Electricity Generation From Self-Charging Inverter. *IJETAE ISSN*, 2250-2459.
- Adewumi, I. (2016). Fuelless Generator: Comparison of Two Prototype Design. *International journal of Energy and Environmental Research* Vol. 4, No.3, pp.37- 44.
- Adewumi, I. (2016). Development of 2.5 kva Self-Induced Power Generating Set, *Sci-Afric Journal of Scientific Issues, Research and Essays* Vol. 4(1), Pp. 890-894, available at <http://www.sci-africpublishers.org>
- Ajav, E. (2012). Agricultural Pollution and Control. *Being an M. Sc lecture note from Department of Agricultural and Environmental Engineering, Faculty of Technology, University of Ibadan, Nigeria.*
- Ajav, E., & Adewumi, I. (2014). *Fuelless generating set: Design, construction & performance evaluation*. Paper presented at the 3rd International Conference Proceedings on Engineering and Technology Research at Ladoko Akintola University of Technology, Ogbomosho.(ISBN: 978-2902-58-6)(3).
- Dipali Sarode, Rutuja Shelke, Shital Mathpati, (2017) "Fuel less Generator: Review" *International Journal for Research in Applied Science & Engineering Technology (IJRASET) ISSN: 2321-9653 Volume 5 Issue VI*, pg 1375-1378.



- Ibrahim, H. E., & Serag, M. F. (2011). Analysis of self excited induction generator using particle swarm optimization. *World Academy of Science, Engineering and Technology*, 57, 236-240.
- Onochie, U., Egbare, H., & Eyakwanor, T. (2015). The Nigeria Electric Power sector (opportunities and challenges). *Journal of Multidisciplinary Engineering Science and Technology*, 2(4), 494-502.
- Otulana J.O, Akinwunmi A.A, Awoyemi J.A, Adeleke M.B, Efunbote Orelaja M.I (2015), Construction of a Fuel less Generator, International Journal of Recent Research in Civil and Mechanical Engineering, Vol. 2, Issue 1, pp:(285-289).
- Rajaendra K. Prasad et al (2012) Modeling and Simulation of an Asynchronous Generator with AC/DC/AC Converter Fed RLC Series Circuit in an Isolated Power Generation System, International Journal of Engineering and Technology Volume 2 No 4.
- Singh, B., Murthy, S., & Gupta, S. (2006). Analysis and design of electronic load controller for self-excited induction generators. *IEEE transactions on energy conversion*, 21(1), 285-293.
- Theraja, B., & Theraja, A. (2007). A Textbook of Electrical Technology 24th Edition, S. Chand and Company Ltd New Delhi-110055.