

See discussions, stats, and author profiles for this publication at: <https://www.researchgate.net/publication/226594811>

# Post Bi-annual Maintenance Performance of Geregu Thermal Power Plant

Article · June 2012

CITATIONS

0

READS

643

5 authors, including:



Akinola Adeniyi

30 PUBLICATIONS 110 CITATIONS

SEE PROFILE



Abdulkadir Baba Hassan

Federal University of Technology Minna

49 PUBLICATIONS 1,575 CITATIONS

SEE PROFILE

Some of the authors of this publication are also working on these related projects:



Adaptation of airbag for cushioning the effect of tyre burst. [View project](#)

# Post Bi-annual Maintenance Performance of Geregu Thermal Power Plant

Abubakar Mohammed<sup>1\*</sup>, Akinola A. Adeniyi<sup>2</sup>, Andrew E. Elaigu<sup>3</sup>, Abdulkadir B. Hassan<sup>1</sup>,  
Abubakar Kandi Mohammed<sup>4</sup>, Paul T. Dyege<sup>5</sup>

<sup>1</sup>Department of Mechanical Engineering, Federal University of Technology Minna, Nigeria

<sup>2</sup>Department of Mechanical Engineering, University of Ilorin, Ilorin, Nigeria

<sup>3</sup>Geregu Thermal Plant, Ajaokuta, Kogi State, Nigeria

<sup>4</sup>Schlumberge, Schlumberger House, Gatwick Airport, Sussex, London, UK

<sup>5</sup>Department of Mechanical Engineering, University of Agriculture, Makurdi, Nigeria

\*a.mohammed@futminna.edu.ng, adeniyi.aa@unilorin.edu.ng, andrel5000@yahoo.com,

abubakarkandi@yahoo.com, abdulkdir\_hassan2003@yahoo.com, paultdyege@yahoo.com

**ABSTRACT** -The continuous firing of a gas turbine engine make it become fouled with airborne contaminants like sand, dust, oil, salt and smoke which encrust the compressor and turbine components. Generally, the deterioration of axial flow compressors is a major cause of loss in gas turbine output and efficiency. The cleaning of the gas turbine compressor is the most effective method of preventing fouling. Cleaning maximises fuel efficiency, the life of the machine and recovers majority of lost power output. The most effective technique of cleaning the compressor and the air-filter of a gas turbine is the offline method. The technique includes injecting water into the compressor when the turbine is turned at cranking speed and requires the turbine to be shut down. This paper presents the performance evaluation of Geregu power plant gas turbine after a bi-annual maintenance operation. The performance parameters such as compressor pressure ratio, compressor discharge temperatures, turbine exit temperatures and power output improved significantly after the bi-annual maintenance operation. The generation utilization index increased from 0.55 to 0.90 and the capacity utilization Index increased from 0.51 to 0.85 after the bi-annual maintenance operation. The station reliability index was 0.47 two months before the bi-annual maintenance operation but increased to 0.99 two months after maintenance, resulting to a total power generation increase from 66,000MWh two months prior to the bi-annual maintenance operation to 140,000MWh two months after the maintenance.

**Keywords:** Turbine, Compressor, Bi-annual maintenance, Air filter, Geregu power station.

## 1. INTRODUCTION

Gas turbine engines are fired continuously for the purpose of power generation, marine and jet propulsion. Overtime, the performance of the gas turbine deteriorated. If not checked, the deterioration will lead to non-recoverable damages of the

gas turbine engine. In Nigeria and other tropical and arid countries where gas turbines are made to operate in harsh climatic edaphic and topographical conditions, gas turbine performances deteriorate rapidly away from the design performance parameters. In some cases lost performance output could be as high as 15% [1]. The major pollutants of gas turbines in these countries are: Salt, Oil, Dust storms and Smoke. The major indicators of performance deterioration of turbines are: Decrease in Turbine and compressor pressure ratios, decrease in turbine exhaust temperature, increase in the compressor discharge temperatures, Low thermal efficiencies, low mass flow of turbine and decrease in the quantity of gas flow through turbine nozzles [2]. In other to sustain performance, availability, profitability and life span of the engine, it becomes inevitable for turn-around maintenance or bi-annual maintenance operations. It has become a norm worldwide for a bi-annual maintenance to be carried out on gas turbine engine after firing continuously for around 6000-8000hrs [3]. However, in regions like Nigeria during the peak of the harmattan season where the parts per million (ppm) of dust particles is at its highest, it result to a greater differential pressure across the filters. And gas turbines operating offshore, where the salinity and the degree of pollutants within the sea body are extremely high, the maintenance operations are usually brought forward [4]. Maintenance operations are relatively cheaper when compared to the cost of lost output in production that will result due to lack of carrying out such maintenance. Typically, a loss of just 5% of output could lead to a revenue loss of over \$3million (3million US Dollars), because over time the revenue accrued or invariably the profit obtained is a direct variation of the megawatts produced [1]. Typically, the thermal efficiency of a gas turbine ranges from about 33-39% at design or optimal points. Other parameters like the compressor pressure ratio, the plant heat rate, mass flow rate vary from one model to another. But they are the performance determinants of a

thermal plant which invariably affect the longevity and profitability of the plant [5]. These performance determinants parameters deviate from design points at specified off design conditions, like ambient temperature and altitude. However, if such deviations go beyond certain limits at any point in time, it will definitely leads to maintenance in order to recover lost output in the gas turbine.

Gas turbine engines, when fired become fouled with airborne contaminants like sand, dust, oil, salt and smoke which encrust the compressor and turbine components. Generally, axial flow compressor deterioration is a major cause of loss in gas turbine output and efficiency. The washing of gas turbine compressor is the most effective method of preventing fouling. Cleaning maximises output, fuel efficiency, life of machine components (bearing and blades) and recovers majority of lost output.

The cleaning of a gas turbine is done either by abrasive, online or offline [6]. The abrasive technique is also known as shot blast method. Walnut shell is the main abrasive used in this method. It has adequate strength and toughness due to its modulus of elasticity of about 117MPa. The blasting is done using crushed nuts, shells and peach stones fed into the inlet air stream while the engine is running, to remove the contaminants. The performance improvements using this technique tend to be short lived with the added drawback of possible damage to protective coatings on the blades. Though is the most effective in removing corrosion deposits, it is generally ineffective at high temperatures, it removes only low quantity deposit, it restore only low percentage of lost output and could block blade cooling passages. The online compressor washing technique is also known as hot wash because it is conducted while the engine is still running. It aims at extending the periods between offline wash through frequent washing of short periods. The washing is done by the utilisation of a set of built in spray nozzles that inject heated distilled water and/or detergent into the compressor while at about 80% load. The washing continues for about 15 minutes. This recovers much of the deterioration that has accumulated in the past 24 hours. It can however not restore optimal power output when compared to offline wash. Also water based online cannot sufficiently remove oily deposits. Chemical based method cannot adequately remove salty deposits and if not properly timed could lower the surge margin of the compressor. It is only performed before a significant fouling of the compressor. The offline method is also known as crank soak or cold method and is performed when the compressor performance degrades by 10% due to heavy compressor fouling. It is undertaken about 2-3 times a year. The technique includes injecting water into the compressor when the turbine is turned at cranking speed and requires the turbine to be shut down. It is the most effective form of cleaning as it occupies less space and so decreases nozzle installation cost. It also provides longer and efficient cleaning and restores nominal power to near optimum [7].

Filters are deemed dirty when the differential pressure across the filters exceed 12mbar for Donaldson filters [4]. A minor or semi major cleaning will be done even if visual inspection states otherwise. The same cleaning is carried out when running hours of the unit exceeds 6000-7000hrs and with a corresponding percentage decrease in component

isentropic and thermal efficiencies, fuel flow rate capacity and output when compared with that of a clean engine performances.

This paper presents the use of the offline technique in the maintenance operation of the air intake-compressor systems of the gas turbine unit after large depletion of performance parameters was discovered. Emphasis will be placed on the effect of cleaning of the air intake, and the compressor during the bi-annual maintenance operations to ascertain the impact of the maintenance operation on the overall performances.

### 1.1 Overview of Geregu power station Ajaokuta

The Geregu thermal power station (GPS) Ajaokuta was commissioned in 2006 by the then Nigeria president Olusegun Obasanjo. The plant consists of three independent units, each being rated at 138MW. The total installed capacity is 414MW. The Plant is located in Ajaokuta, Kogi state, Nigeria. Below is the detailed specification of a unit at design point. The plant is also served by a water treatment plant which produces demineralised water for cooling of the various sub systems making up the units. The Natural gas for firing the turbine is provided by the Nigerian gas company.

Table 1. ISO performance of Siemens V94.2[8].

Description	Values
Length (m)	6.7056
Width (m)	2.5654
Height (m)	2.04216
Weight (kg)	1500
Overall pressure ratio	22:1
Exhaust tempt ( <sup>0</sup> C)	540
Mass flow rate (kg/s)	500
Number of compressor stages	10
Number of turbine stages	4
Power output (MW)	138
Power turbine speed (rpm)	3600
Thermal efficiency (%)	34

### 1.2 Indexes Theory

Theoretically, the clean engine figures are obtained from thermo dynamical relationships obtained from Carnot equation stated below:

$$T_t = T_1 \left( \frac{P_2}{P_1} \right)^{\frac{\gamma-1}{\gamma}} \tag{1}$$

Where  $T_1$  is the temperature of clean engine at particular temperature (<sup>0</sup>C),  $(P_2/P_1)$  is the pressure ratio across

compressor section (bar) and  $(\gamma - 1)/\gamma$  is the critical air ratio index which is constant at 1.4.

The total generation of the gas turbine is given as:

$$G_T = 24 * N_m * U \quad (2)$$

The average generation index is defined as:

$$I_G = \frac{G_A}{G_T} \quad (3)$$

The unit reliability is defined as:

$$I_R = U_n * R_h - \frac{D_{unav u}}{N_{RH}} \quad (4)$$

The availability index in terms of running hours is given as:

$$I_{Ava} = \frac{R_H}{R_T} \quad (5)$$

The total expenditure is defined as:

$$E_T = C_R + C_G + C_P * D_P \quad (6)$$

Taking the plant profitability index into consideration, the generational unit cost is defined as:

$$G_C = \frac{E_T}{T_E} \quad (7)$$

Where  $G_T$  is the total generation (MWh),  $U$  is the number of units available,  $N_m$  is the number of days (month),  $I_G$  is the average generation index,  $G_A$  is the actual generation,  $I_R$  is the unit reliability index,  $N_{RH} D_{unav u}$  is the downtime of unavailable unit,  $R_h$  is the running hours,  $U_n$  is the number of available units,  $E_T$  is the total expenditure,  $D_P$  is the percentage depreciation,  $C_P$  is plant cost,  $C_G$  is the cost of gas,  $C_R$  is the recurrent cost,  $G_C$  is the generation unit cost and  $T_E$  is the total energy sent.

## 2. MAINTENANCE OPERATION

### 2.1 Introduction

The first step in the maintenance process is the isolations of various sub-systems in the gas turbine unit and the principal central control (PCC) hall in order to enhance safety of operation.

#### 2.1.1 Isolation of the power supply unit

The unit 6.6KVA feeder circuit breaker was opened and racked out and equally tagged to alert maintenance personnel. The stator frequency converter (SFC) transformer control and the stator exciter equipment (SEE) transformer control were racked out and equally tagged. The high voltage transformer earthing was then restored in order to enhance adequate grounding. Finally, the isolators (transmission equipment) were opened to ensure safety of operation.

#### 2.1.2 Isolation of the air intake unit

The air intake subsystem was de-energised to enhance safety of workmen. The intake filters and coalescers removed and stacked together for cleaning. At the PCC hall, the 415V AC supply breaker was racked out to the compressor air shutoff valve. The 415V circuit breaker

of the compressor was racked out and tagged. The 415V circuit breaker supply to the inlet guide vanes (IGV) adjuster was also racked out and tagged. The last stage of isolating the air intake unit was to rack and tag the 220V DC supply to the compressor blow off valve.

#### 2.1.3 Isolation of the generator cooling system

The unit 415V AC supply to the generator cooling fans sub groups A & B were racked out. The circuit breakers for the 415V AC supply to the generator cooling pumps 1 & 2 were racked out appropriately.

#### 2.1.4 Isolation of the lubrication system

The 415V circuit breaker supply to the oil vapour extractor fans was racked out. The 415V circuit breaker supply to the lift oil pump was racked out. The 415V circuit breakers supply to the auxiliary and main lube oil pumps were racked out. The supply breakers to the emergency lube oil pumps and the turning gear shutoff valves were also racked out. And the 415V circuit breaker supply to the lube oil cooler fans is also racked out.

#### 2.1.4 Isolation of the gas supply system

The unit 220V circuit breaker supply to the Natural gas unloading valve is racked out. The 220V circuit breaker supply to the line vent valve was racked out. The 220V circuit breaker supply to the main fuel inlet valve and the fuel gas by-pass valves 1 & 2 were racked out. The unit inlet valve gas shut off valves and the inlet gas vent valves were fully opened.

### 2.2 Air filter cleaning

After the various isolations, the intake air system, the pulse filters and the coalescers were all vacuumed. Damaged and worn out filters were replaced with new ones. The cobwebs and dirt were cleaned off from the filter housing. The above process took two (2) weeks.



Figure 1. Pulse filters before cleaning



Figure 2. Pulse filters after cleaning

### 2.3 Compressor washing

The constituent of the solvent used in the compressor wash are made of 100ppm total solids, 25ppm total alkali metal and 1.0ppm of other metal. The pH of the solvent was 6.5-7.5. The solvent solution mixture of 500 litres composed of mixed washing fluid of 100litres and demineralised water of 400 litres was used for the washing of the compressor.

#### 2.3.1 Compressor washing Procedures

The gas turbine unit was shut down and allowed to cool. The differential temperature between the wash water and inter stage wheel space was checked to ensure that it was below 67°C. The operating compressor was de-energised during the pulse mode waterwash cycle and the intake air flap was opened to enhance airflow to prevent excess collection of water within the compressor assembly which could affect the compressor blades. The inlet guide vanes were manually opened to 100% to ensure entrance of good quality air mass flow to hasten loss of moisture to the atmosphere. The medium pressure pumps were on to ensure continuous flow of pressurised demineralised water. On the operation monitor, the compressor turbine wash and the stator frequency converter (SFC) option were selected and all water drains were opened. The actual wash commenced with the shutting down of the turbine for 12hrs while ignition switch and gas pipe to exhaust manifold were fully disconnected. The compressor wash option was activated on the monitor and the pump sprayer was filled with crank solution. The turning gear valve of the crank unit was on. A jet spray valve was used to spray the compressor turbine with 25% of the crank solution. The turning gear valve of the crank unit was then off and the wash solution was allowed to stay in the turbine for 15 minutes. The speed of the machine was then taken to compressor washing speed of 600rpm (SFC initiated). While at this speed, the remaining 75% of the washing solution was injected into the compressor after which the jet and the SFC were put off.

After about 10 minutes, the turning gear of the crank unit was and about 25% of demineralised water solution only was introduced using the jet spray. The SFC was then initiated with the compressor taken to 600rpm again. The remaining 75% of the demineralised water was injected using the conical spray and the water solution was then flushed out. All the drain valves were then closed. Finally, the machine was then returned to turning gear speed awaiting startup.

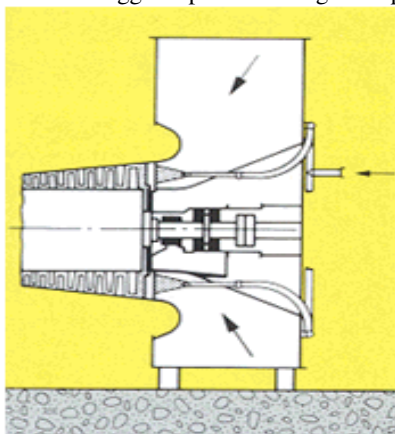


Figure 3. Offlinesystems with direction of nozzles [1]



Figure 4. Compressor blades before cleaning

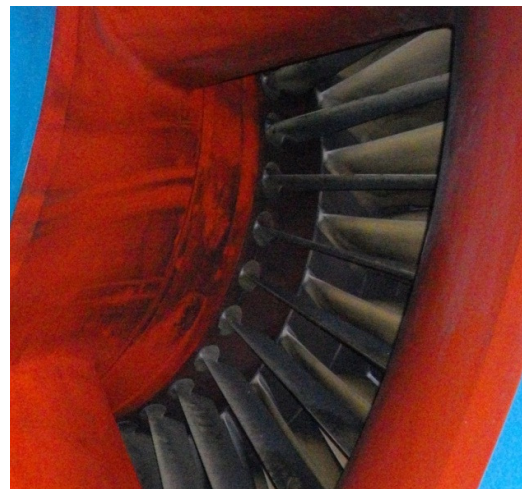


Figure 5. Compressor rotor and stator blades after cleaning

### 3. RESULTS

The performance of was recorded at 2 months and 1 month before the bi-annual maintenance and is shown in table 2 and table 3 respectively. The performances of a clean engine and 2 months after maintenance were recorded and the results shown in Table 4 and Table 5 respectively. Figure 6 to Figure 9 are graphical comparison of the performances of the engine at various temperatures.

Average generation index at 2 months before the bi-annual maintenance operation was 33%. Average generation index at 1 month before the bi-annual maintenance was 23.31%. Average generation index at 2 months after the bi-annual maintenance operation was 75%.

The reliability index of the station at 2 months before the bi-annual maintenance was 48%. The reliability index of the station at 1 month before the bi-annual maintenance was 36.5%. The reliability index of the station at 2 months after the bi-annual maintenance was 94%.

The availability index at 2 months before the bi-annual maintenance was 75%. The availability index at 1 month before the bi-annual maintenance was 62%. The availability index at 2 months after the bi-annual maintenance was 97%.

The plant profitability index at 2 months before the bi-annual maintenance was 34%. The plant profitability index at 1 month before the bi-annual maintenance was 38%. The plant

profitability index at 2 months after the bi-annual maintenance was 19%.

Table 2. Two months before bi-annual maintenance

Ambient temp. (°C)	Pressure ratio (bar)	Compressor discharge temp.(°C)	Turbine exit temp. (°C)	Power (MW)
30.5	6.99	301	526	59
28.8	7.25	294	528	62
26.4	7.73	297	534	73

Table 3. One month before bi-annual maintenance.

Ambient temp. (°C)	Pressure ratio (bar)	Compressor discharge temp.(°C)	Turbine exit temp. (°C)	Power (MW)
30.5	6.97	300.71	500.9	50
28.8	6.79	291.18	471.7	43
26.4	8.11	307.97	537.4	81

Table 4. Clean engine performance

Ambient temp. (°C)	Pressure ratio (bar)	Compressor discharge temp.(°C)	Turbine exit temp. (°C)	Power (MW)
30.50	11	328	540	138
28.8	11	325	540	139
26.4	11	320	540	140

Table 5. Two months after bi-annual maintenance

Ambient temp. (°C)	Pressure ratio (bar)	Compressor discharge temp.(°C)	Turbine exit temp. (°C)	Power (MW)
30.50	9.1	326	527	100
28.8	10.71	323	524	130
26.4	11.0	318.5	540	138

Table 6. Engine Performance computations

Description	Before	After
Generation (total)	66,328	140,328
Load factor	0.25	0.76
MWh lost to grid disturbance	367.10	0.00
Capacity Utilization Index	0.51	0.85
Generation Utilization Index	0.55	0.9
Station Reliability Index	0.47	0.99
Staff Cost Index(N/STAFF)	43.00	22
Average Plant Heat Rate (J/MWh)	20,129	12,129
Total Volume of Gas Supplied	850.34	865.34
Total Volume of Gas Required	850.34	865.34
Duration(hrs) of Gas Supply Interruptions	170.41	0
MWh Lostto GasSupply Interrupt.	276	0

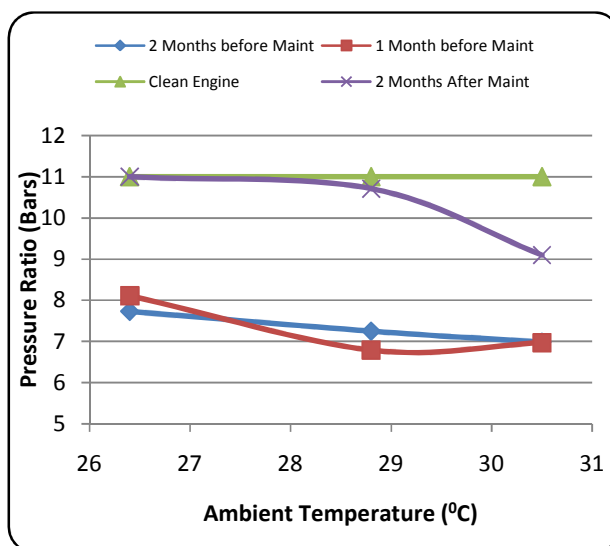


Figure 6. Compressor pressure performance



4. DISCUSSIONS OF RESULTS

4.1 Maintenance

In figure 6, the compressor pressure ratio was compared at different ambient temperatures for four scenarios: clean engine, 2 months before, 1 month before and 2 months after the bi-annual maintenance operation. The higher the pressure ration, the better the performances of the plant. The clean engine pressure ratio remains constant, an indication of a perfect condition. Two months before the maintenance, the ration of the plant reduces with increase in ambient temperature. At 30.5°C, the pressure ratio of the plant two months maintenance has a deviation of 37%. This deviation increases to 37% at one month before the maintenance. A tremendous improvement was noticed two months after the maintenance as the deviation reduces to 8%.

The compressor discharge temperature (CDT) of the plant was expected to increase with increase in ambient temperature. It was observed that twomonthsand one before the bi-annual operation, the compressor discharge temperature reduces with increase in ambient temperature and attained a deviationof 8.3%and 9% respectively. However, two months after the bi-annual maintenance operation, it was minimised to 0.6% as shown in figure 7.

A clean machine should have no change in the turbine discharge temperature (TDT). It was observed that two months and one month before the maintenance, the TDT reduces with increase in ambient temperature and attained a deviations of 3% and 7%respectively. The impact of maintenance was glaring when twomonthsafter the maintenance operations the deviation was less than 2% (figure 8).

The power output of a clean engine 140MW. As the ambient temperature increases, the output was unchanged. Two months before the maintenance operation, the output of the turbine was 76MW at 26.4°C ambient temperature. It was also observed that the output reduces to 60MW at 30.5°C ambient temperature. One month before the maintenance operation, the out was 50MW at an ambient temperature of 30.5°C. After the maintenance operation, the output was observed to be 100MW at 30.5°C. The operation of the turbine was optimal at 26.5°C when the output was observed to be the same with that of a clean engine. In terms of deviations, it was 57.3% and 63.7% for two and one month respectively before maintenance,and dropped to 9.4%two months after the maintenance operation.

4.2 Indexes Compared

The indexes obtained from calculations using equations 1 to 7 show similar trend in the performance of the turbine as discussed above. A significant reflection of the usefulness of the bi-annual maintenance operation can easily be observed in the profitabilityindex values. It is the ratio of expenditure to revenue. It indicate how when the company is doing. The index was 34% and 38% ofgeneration two and one monthbefore maintenance respectively, but reduces significantly to 19%. This reduced value is a clear indication

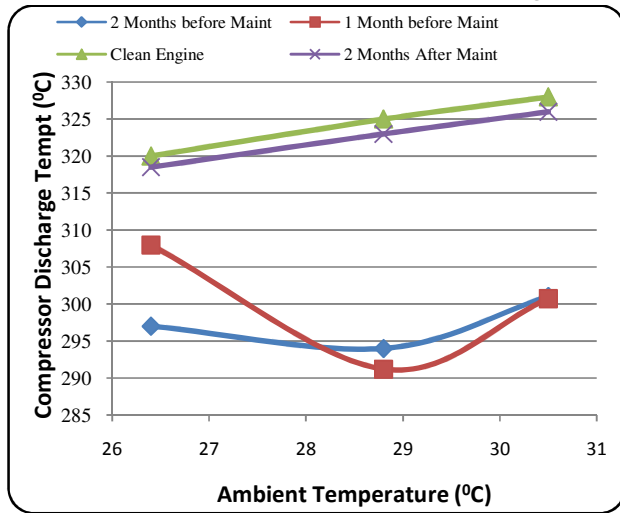


Figure 7. Compressor discharge performance

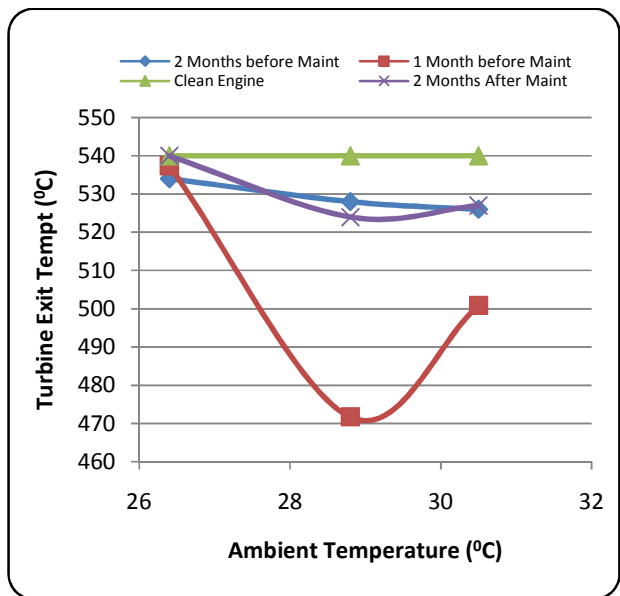


Figure 8. Turbine exit temperature performance

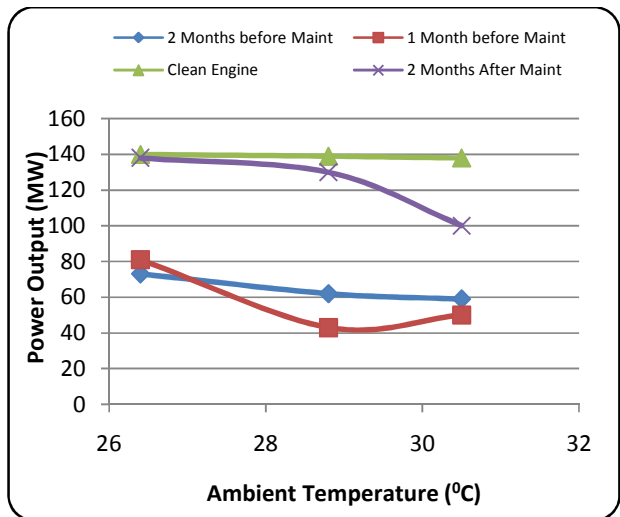


Figure 9. Power output engine performance

of significant increase in the organisational profit. Table 6 shows that the total generation increased from 66,328 two months before bi-annual maintenance operation to 140,328 two months after the maintenance. The plant has more than 100% increase productivity. At the same time the generation utilization index also increased from 0.55 to 0.90. The capacity utilization Index increased from 0.51 to 0.85 after the bi-annual maintenance operation. It is significant to note that the station reliability index was 0.47 two months before the bi-annual maintenance operation but increased to 0.99 two months after maintenance.

#### 4.3 Economic Impact of Maintenance Operation

From table 6, it can be seen that the total generation at two months before the maintenance operation was 66,328 MWh and total generation increased to 140,328 MWh two months after the maintenance operation. This is an increment of about 111%. Assuming 1 MWh of generation was sold at \$0.06, the profit obtainable after the maintenance was about \$5,000.00. This translates to an increase of 111% assuming equal number of staff strength and a marginal increment in gas consumption. Also, when post maintenance generation values were compared to those obtained one month before maintenance, a profit of 210% was obtained. This amounts to an increase of more than \$6,000 assuming generation being sold at \$0.06 per MWh with equal staff strength and a marginal increase in gas consumption. All these positive indices are due to increased availability of plant as a result of recovered output after maintenance which was earlier lost to deterioration.

#### 5. CONCLUSION

A successful bi-annual maintenance operation was achieved by using the offline method to clean the air filter and the compressor. After the maintenance operation, it was discovered that deviations of performance parameters such as compressor pressure ratio, compressor discharge temperature, turbine exit temperatures and power output improved significantly after the bi-annual maintenance operation. A total power generation increase from 66,328 MWh two months prior to the bi-annual maintenance

operation to 140,328 MWh two months after the maintenance can be directly related to the overall turnaround maintenance operations. This is an increase of more than 100% in productivity level and directly implies higher revenue from wattage sold. The generation utilization index also increased from 0.55 to 0.90. The capacity utilization Index increased from 0.51 to 0.85 after the bi-annual maintenance operation. It is significant to note that the station reliability index was 0.47 two months before the bi-annual maintenance operation but increased to 0.99 two months after maintenance.

#### ACKNOWLEDGEMENT

The authors will like to thank the management and staff of Geregu Power plant, located at Ajeokuta in Kogi State, Nigeria for assisting in the bi-annual maintenance operation and making the data available during the investigation.

#### REFERENCES

1. Geregupower plant digital /analogue sheets
2. SiemensEnergy(2008)V94.2Industrialsgasturbinesh [http://www.siemenspower.com/prod\\_serv/products/airo\\_turbines/en/lm6000.htm](http://www.siemenspower.com/prod_serv/products/airo_turbines/en/lm6000.htm) (re-accessed 7th March, 2012).
3. Earl Logan Jr. and Ramendra Roy. (2003). Hand book of turbomachinery. CRC, 2<sup>nd</sup> edition.
4. Geregu powerplant operation manual.
5. Walsh, P.P. and Fletcher P. (2004), Gas Turbine Performance. Blackwell Publishing; 2<sup>nd</sup> edition.
6. Saravanamuttoo, H., Rogers, G. and Cohen, H. (2002). Gas Turbine theory, Prentice Hall, 5<sup>th</sup> ed.
7. Abam, F. I., Onyejekwe, D. C. and Unachukwu, G. O. (2011). Effect of Ambient Temperature on Components Performance of an In-Service Gas Turbine Plant using Exergy Method", Singapore Journal of Scientific Research. 1 (1): 23-27.
8. Baylis R.J. (1976). Design of a 10 MW industrial gas turbine. PhD Thesis, School of Mechanical Engineering, Cranfield University, UK.